

OP-613 Operator Panel

The OP-613 Operator Panel is a low cost/high performance man/machine interface with a broad range of operator input and display capabilities. The panel includes four field points which can be used for either setpoint entry or data display, four pushbuttons and two large indicator lamps.

The four digit numeric LED display is associated with four field points. The user can select which field point to project on the display by use of the SELECT button. The LEDs adjacent to the user defined field point labels highlight which field point is active. Once selected, the display will either show the related data or project the current setpoint value.

Setpoint adjustment can be performed by use of the arrow keys to move the value up or down. Once set, the value is saved into non-volatile memory. It is permanently stored, whether power remains on or not, until the next time it is changed by the operator.

Lamps and buttons can be custom labeled by the user with plastic inserts. The inserts can be custom legended with text and/or graphics, and slip into a protective pocket behind the faceplate.

The OP-613 Operator Terminal is part of Optimization's **OptiMate®** series. Each OptiMate module is designed to connect to a PLC with a single cable connection. OptiMate panels can be used individually, or together with any combination of other OptiMate panels.

When used with a PLC, operation is transparent to the user. Panel functions tie directly into your PLC ladder logic program. The OP-613 takes care of the rest.

Applications

- Machine control
- Process control
- Security systems
- HVAC
- Plant monitoring/control
- PLC applications
- Microprocessor applications

Features

- Setpoints or display points
- Four digit numeric display
- Two large LED light bars
- Four tactile snap membrane function buttons
- Buttons independently configurable for momentary or alternate action operation
- PLC compatible
- RS232/RS422 communications
- Stand alone operation capable
- Multipanel operation capable

Contents

Configuration Options

- Stand Alone
- PLC Multi-Module

Use with a PLC

- Examples of Use with a PLC
- Direct PLC

Examples of Use with an

- Allen Bradley PLC
- SetUp and Interconnect

- Legending the Lamps, Buttons and Field Points
- Connection to the System

Configuration

- Configuration Selections


Label Templates

Specifications

OptiMate is a registered trademark of Optimization, Inc.

copyright ©1997, Optimization, Inc.

Configuration Options

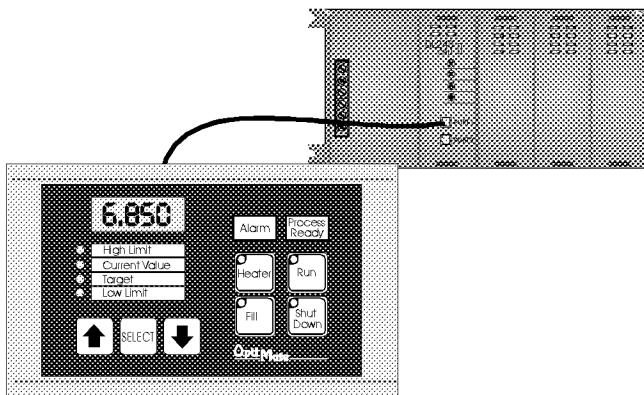


PLC Stand Alone

OptiMate panels plug directly into most PLCs. A cable connection allows you to interface and control the OptiMate panel via PLC data registers and ladder logic.

The OP-613 operator panel uses a bank of PLC registers. Complete operator interface is performed with 8 PLC registers for data entry and display, function key interface and indicator light control. The OP-613 continuously accesses these PLC registers and performs operations under ladder logic control on a real time basis.

PLCs are slave devices on their standard communications ports. This means that a panel attached to the standard port must control the transfer of information by reading and writing the PLC registers. OptiMate panels will perform this communications for most major PLC protocols. Configuration for particular PLC protocols and interconnect cabling is covered in the following pages.

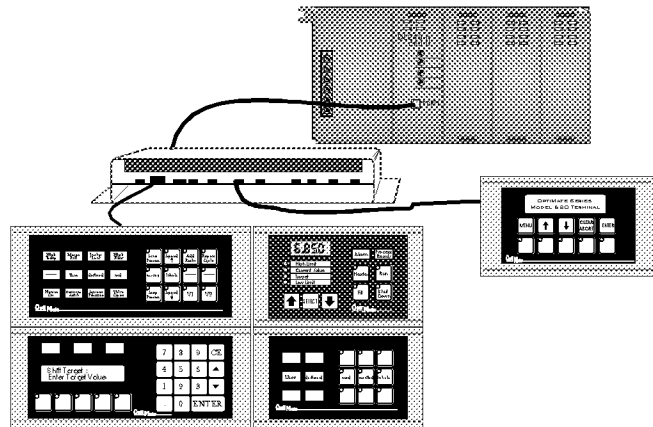

PLC Multi Panels


Larger systems involving operator panels can be successfully addressed using OptiMate panels. These applications utilize the OP-9001 Communications Master to transfer data between the PLC and the individual OptiMate panels. OptiMate panels can be located together to form custom panels or they can be distributed anywhere within 4000 feet.

The OP-9001 Communications Master provides a transparent interface between the PLC and a group of OptiMate modules. The communication interface between panels requires only four wires.

System configuration is simple via an interactive configuration program that runs on any IBM PC compatible computer.

This modular approach to custom applications provides a nearly limitless number of possibilities.

Use with a PLC

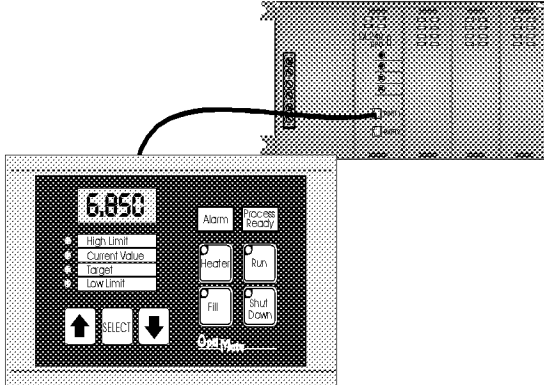

Register	MSB				LSB									
X	L2	L1	F1	F2	B4	B3	B2	B1	Indicator Light/LED On/Off/Flash					
X+1					B4	B3	B2	B1	Button On/Off Status					
X+2	Field Point 1 data cell													
X+3	Field Point 2 data cell													
X+4	Field Point 3 data cell													
X+5	Field Point 4 data cell													
X+6	Field Point force data cell													
X+7	FSP	FP4	FP3	FP2	FP1		F1	F2	F3	B4	B3	B2	B1	Force Commands

Register Bit Association

Memory Mapping

Memory mapping is a technique that “maps” the memory of an OptiMate panel into the registers of the programmable controller. By knowing where the data of the specific OptiMate panel is mapped, this data can be moved, changed or monitored using ladder logic.

The term PLC register is used for the area of memory within the programmable controller used for data exchange with the OP-613. PLC registers are sometimes known as data registers or internal registers.

MSB																LSB
16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	
PLC Register																

The OP-613 Terminal Panel uses a bank of 8 contiguous PLC registers. The register set definition is shown in the table below.

PLC Register	Register Function
X (first register of bank)	Lamp and inset LED control
X+1	Function button status
X+2	Field point 1 data cell
X+3	Field point 2 data cell
X+4	Field point 3 data cell
X+5	Field point 4 data cell
X+6	Field point force data cell
X+7	Force control

Register Definition

The following describes the function of the registers shown in the table.

- Register X - Control outputs for the 2 indicator lamps and, if LED separation is selected, the inset LEDs in the momentary pushbuttons.
- Register X+1 - Button status for the four function buttons.
- Register X+2 - Field point 1 data (either setpoint input or display output, as configured)
- Register X+3 - Field point 2 data.
- Register X+4 - Field point 3 data.
- Register X+5 - Field point 4 data
- Register X+6 - Force data. Value to force setpoint equal to when force operation is initiated by the PLC program.
- Register X+7 - Force control. This register controls the forcing of setpoints or button state. The most significant bits of this register control setpoint force. The least significant control pushbutton force.
 - > FSP - When active, the Field point force data (X+6) will be forced into the field points set to be forced (FP1-FP4). Once the force operation takes place, the OP-613 will automatically clear FSP.

- > FP1-FP4 - Used to identify which setpoints must be forced.
- > F1 - When set, all alternate action buttons B1-B4 will be forced to the state (on or off) selected in the low 4 bits (B1-B4) of this register. Once the force operation takes place, the OP-613 will automatically clear F1.
- > F2 - When set, all alternate action buttons matching the bits set in B1-B4 of this register will be forced on. Once the force operation takes place, the OP-613 will automatically clear F2.
- > F3 - When set, all alternate action buttons matching the bits set in B1-B4 of this register will be forced off. Once the force operation takes place, the OP-613 will automatically clear F3.

Operational Overview

Reading a Setpoint

Setpoint data is continuously and transparently written to the associated PLC register. To access and use the setpoint data, simply reference the relevant PLC register (X+2 through X+5) in your PLC program.

Writing a Display Point

Writing a display value simply requires writing data into the associated PLC register. The OP-613 will automatically retrieve and display the data.

Forcing a Setpoint

There are times when it is necessary for the PLC program to initialize or override a setpoint. The capability to do so is provided as the Force Setpoint function.

To force a setpoint to a given value, the value should be placed in register X+6. Next the bit(s) corresponding to the setpoint(s) to be forced and the FSP bit must be set. When the OP-613 panel has forced the setpoint to the required value, it will clear register X+7.

Reading Pushbutton Status

Once the panel is configured and connected to the PLC, reading a button's status simply entails reading the appropriate register bit. In typical applications, a pushbutton appears in PLC ladder logic as a contact. The register bit association is shown in the table on the previous page. The OptiMate panel will automatically place status into this register. A 1 (or contact closed) indicates active or "on" condition.

Turning on a Lamp

When configured for PLC operation, turning on a lamp simply requires the writing of a 1 to the appropriate register bit. With most PLCs this is accomplished by activating a coil in the PLCs ladder logic. The OptiMate panel will automatically retrieve the register data and light any lamps whose bits are set.

A lamp must be turned on in order for the flash control bits to have any effect.

Flashing an Inset LED

As shown in the table, the second register will initiate lamp flash. To flash a lamp, the lamp must be on and lamp flash bit must be set.

Lamp flash is approximately .5 seconds on and .25 seconds off.

Turning on the Inset Indicator Light

In most cases, the LED inset in each button simply provides a visual indication of the status of the button. However, if a module is configured for LED separation mode, a momentary button's indicator light can be set directly from the PLC. In LED separation mode, turning on a lamp simply requires the writing of a 1 to the appropriate register bit. The register bit association is shown in the table on the previous page. The OptiMate panel will automatically retrieve the register data and light any lamps whose bits are set.

LED separation is available only for momentary pushbuttons.

Flashing an Inset LED

As shown in the table, the fourth register will initiate inset LED flash. To flash an LED, the LED must be on and LED flash bit must be set. In normal mode, LED "on" status simply reflects pushbutton status. In LED separation mode, LED "on" status is set directly via PLC register bits.

Lamp flash is approximately .5 seconds on and .25 seconds off.

Button Force Commands

If the OP-613 panel is configured for force capability, the PLC can directly control button status when desired. This may be desirable for initialization purposes.

The force capability also may prove useful for functions initiated from the panel pushbuttons. For example, consider a situation where an operator initiates a control process by pressing an alternate action panel button. The button status and indicator light would stay on and lighted to indicate that the function is still in process. At the end of the process, the PLC program could force the button status off.

There are three types of force functions available. These are described below.

Force function	Description
F1 (Force buttons status)	When the F1 bit is set, all buttons will be forced to the status set in the force register (X+7) bits B1-B4. Once these buttons are forced to the status set, the OP-613 will automatically clear register X+7.
F2 (Force buttons on)	When the F2 bit is set, all buttons matching the bits set in the force register (X+7) will be forced on. Once these buttons are forced on, the OP-613 will automatically clear register X+7.
F3 (Clear buttons)	When the F3 bit is set, all buttons matching the bits set in the force register (X+7) will be forced off. Once these buttons are forced off, the OP-613 will automatically clear register X+7.

Force obviously applies only to alternate action pushbuttons.

Examples of Use with a PLC *Direct* PLC

Register Usage

The OP-WINEDIT Configuration Editor allows you to configure a module to use a block of registers at a starting value that you define. For a PLC *Direct* 105, 205, 350 or 405 PLC the recommended memory to use is the general purpose data words starting at V2000 and V4000. For the 305 family, the recommended memory is the registers beginning at R400. Any block of registers within the data word range can be used.

The middle 5 PLC registers (X+2 thru X+6) in the block used by the OP-613 panel are used for numeric information. As such they are ideally suited for the general purpose data registers (V2000 and V4000 area for the 105/205/350/405 and R400 range for the 305). The first two and last registers use individual bits for control and status. These registers are better suited for the control relay register range of memory. The solution to this minor conflict is to define the base register address in general purpose data register memory and place a rung in your PLC program to copy the first and last registers to/from control relay registers.

The following table lists the control relay register addresses for the various PLC *Direct* PLCs.

PLC <i>Direct</i> CPU	Control Relay Register address range
DL130	V40600-V40617
DL230	V40600-V40617
DL240	V40600-V40617
DL250	V40600-V40617
DL330	R016-R037
DL330P	R016-R017 and R020-R027
DL340	R016-R037 and R100-R106
DL350	V40600-V40617
DL430	V40600-V40635
DL440	V40600-V40677
DL450	V40600-V40777


The examples on the following pages use an OP-613 connected to a PLC *Direct* 105/205/405 series PLC. The OP-613 is configured for a base address of V2000. **The program rung on the right should be placed in the program to copy the status register to V40600 and copy from V40601 to the control register.**

With the rung shown placed into the PLC program, the button status and lamp control bits will be control relays. The register association is shown in the figure below.

Register	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	bit
V40600	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	Lamp Control
V40601	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	Button Status

This will result in the following control relay association for the lamp control and button registers.


Lamp Control Register		Button Status Register	
bit	relay	bit	relay
B1	C0	B1	C20
B2	C1	B2	C21
B3	C2	B3	C22
B4	C3	B4	C23
L1	C5		
L2	C6		
B1F	C10		
B2F	C11		
B3F	C12		
B4F	C13		
L1F	C15		
L2F	C16		

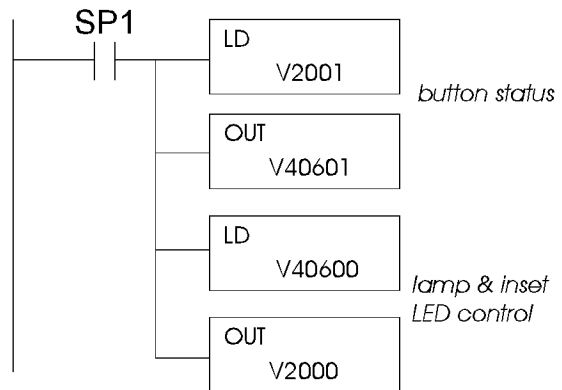

Operations with Lights & Buttons


Turning on a Lamp

Turning on a lamp in the OP-613 simply requires activating its associated control relay coil. In the figure below, lamp 2 will be turned on whenever input X1 is active (energizing C6).

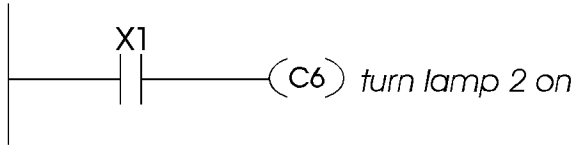

Flashing a Lamp


To flash a lamp, you simply need to both turn it on and set the associated flash bit. The example below shows a 105/205/350/405 program used to flash lamp 2 whenever X5 is energized.

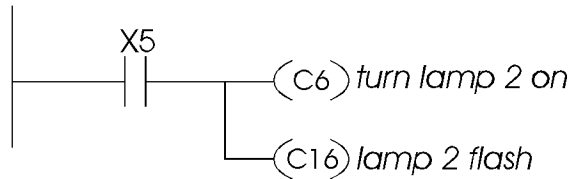


Flashing an Inset LED

To flash an inset LED, you simply need to both turn it on and set the associated flash bit. If the panel is not set up for LED separation, status is simply the button state. For momentary buttons with LED separation enabled, the on/off state is controlled by the PLC as shown in the previous example. For alternate action buttons, on/off state is always the button state.

The example below shows a 105/205/350/405 program used to set the LED inset in momentary button 3 to flash whenever X5 is energized.

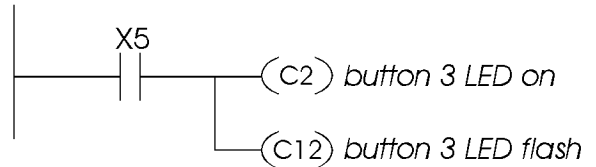


If the panel has been configured with button 3 being an alternate action button, the LED will operate as shown in the example and table below.

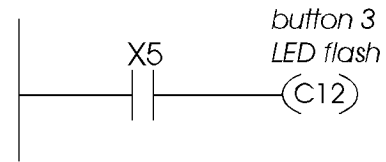

Using a Function Button


The four function buttons will appear as control relay coils in your program (assuming the register copy rung described previously is in your program). The following example turns on output Y1 when button B2 is active.

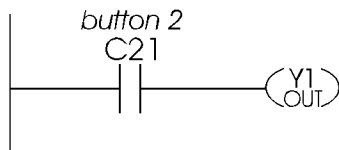

Button State	X5 State	LED operation
Inactive	de-energized	Off
Inactive	energized	Off
Active	de-energized	On solid
Active	energized	Flashing

Lighting an Inset LED

In LED separation mode, the LEDs in the corner of each momentary pushbutton may be directly controlled by the PLC program. The following example shows a segment of a 105/205/350/405 program that will light button 4's inset LED whenever input X7 is energized. *In order for this to work, the panel must be configured for LED separation and button 4 must be a momentary pushbutton.*

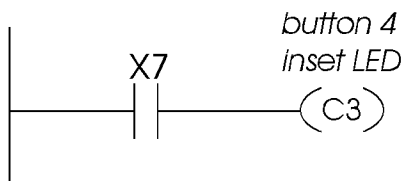


Setpoint & Display Operations

Displaying Numeric Data


Displaying numeric data in one of the 4 field points is a very simple process. During the initial configuration, make sure you define the point as a display point, not a setpoint. When this is done, the PLC program must simply put data to be displayed into the register associated with the display data field.

The figure below illustrates a numeric display application with a PLC Direct 105,205,350 or 405 series PLC. In this application, the OP-613 is configured for a base address of 2000 and field point 2 for display. A value, held in V2106 must be displayed in field point 2 as long as X5 is active. The example shows the value transferred from V2106 to V2003. It will be displayed as field point 2.

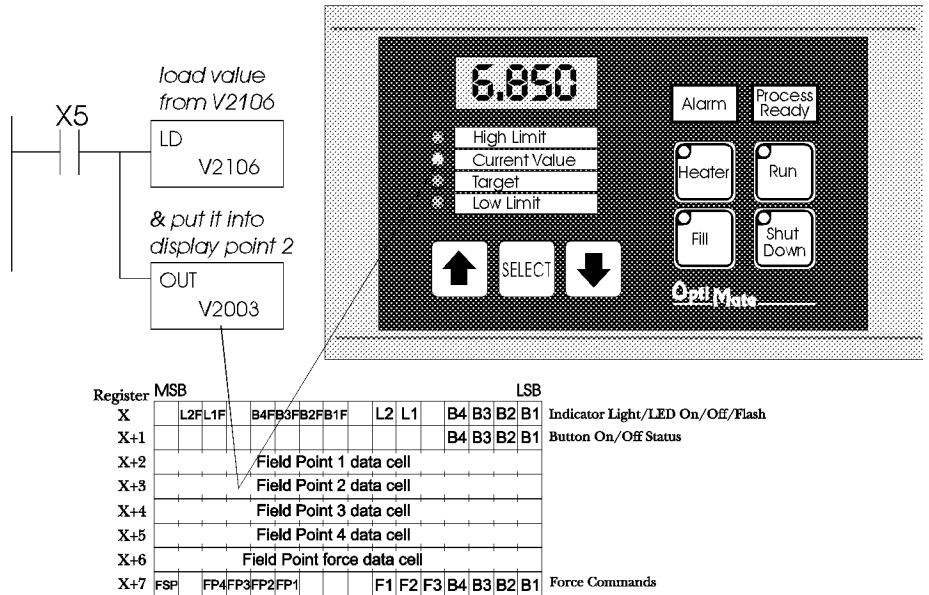

Reading a Setpoint

The following example uses an OP-613 at base address 2000. Field point 1 has been configured as a setpoint. In the example program, field point 1 is a High Limit setpoint. The program shown checks a value, held in V4065 against the setpoint whenever C71 is active. If the value exceeds the setpoint, Y10 will be turned on.

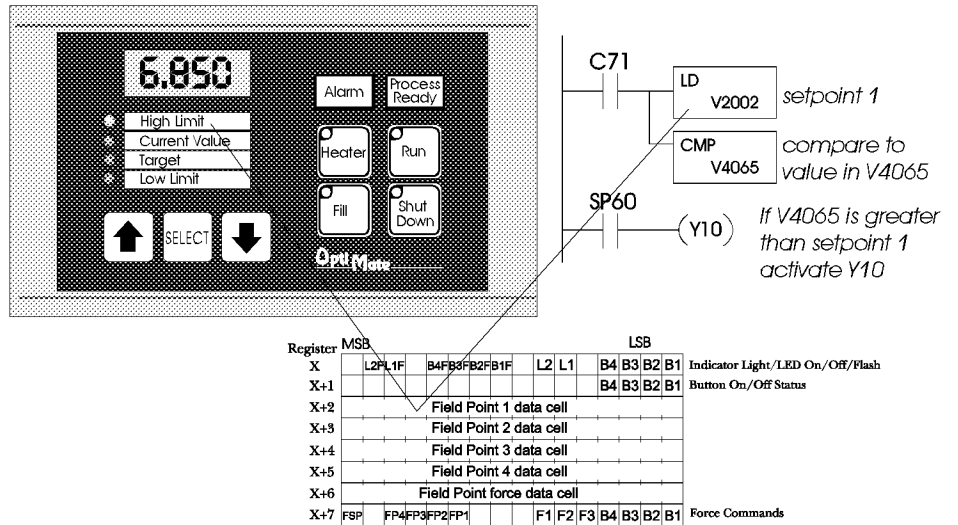

Using Force Functions

The OP-613 gives you the ability to force alternate buttons to a given state and force setpoints to a given value. This capability may or may not be used on a given application. There are applications when it is desirable to have the PLC program automatically set or clear a button based on operational state. There are also cases when forcing a setpoint to a predetermined value is useful. Obviously, this capability should be used carefully.

The last two registers in the register bank are associated with force operations. Their use is detailed below.

Forcing Button Status

One of the more advanced capabilities of the OP-613 panel is the ability to force button state from the PLC program. This may be desirable, for example, if an alternate action is used to start a function process. When it is pushed and while the function is active, the button will remain on. You may want the PLC program to clear the button at the end of the function process.

Another example is one of a system that has individual enable or on/off (alternate action) buttons for several different device. You may also have other buttons (probably momentary) that enable a group of these same devices. You may want your program to force on the device enable buttons when the group enable button is pressed.

There are many other cases where button force capability can be useful in a system.


There are three types of force functions available for the OP-613 panel - force status, force on and force off. All three functions require moving appropriate data into the PLC registers defined as Force Data & Commands (see the table described in "Use with a PLC").

Note : Force only applies to Alternate Action pushbuttons

Force Button Status


This function is used to set the state (on or off) of every alternate action pushbutton in the panel. To use the "Force Button Status" function, simply set the F1 bit to 1 and all buttons that you want to be on to 1, while leaving all other bits off. The example on the right shows buttons 1 and 4 being forced on and the other two buttons forced off when C62 is active.

Notice that C62 is used as a set/reset type relay. The force should be written to the force register once. The OP-613 will automatically clear this register when the force is complete. This will normally happen very quickly (less than a second). The fact that the OP-613 clears the force control register when the operation is done can be used by the PLC program to verify operation. However, this is generally not necessary.

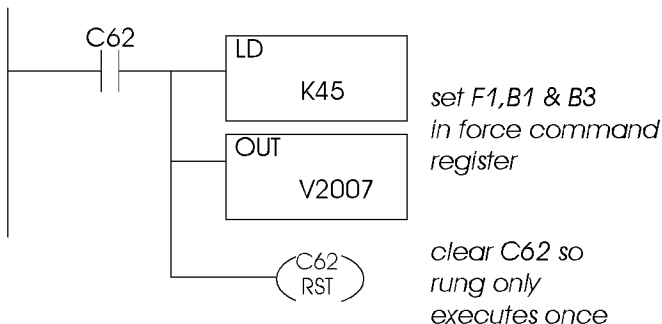


Force Button(s) On

This function is used to turn individual button(s) on without affecting the state of any other buttons. To use the "Force Buttons On" function, set the F2 bit to 1 and all buttons that you want to turn on to 1. Any buttons associated with bits that are left at '0' will not be affected. The following example shows buttons 1 and 2 being forced on when C62 is active.

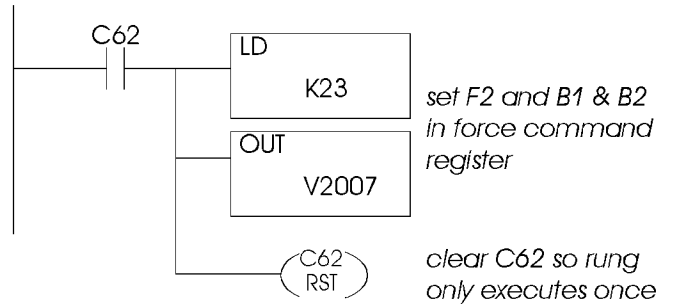

Clear Button(s)

This function is used to selectively turn individual button(s) off without affecting the state of any other buttons. To use the "Clear Buttons" function, set the F3 bit to 1 and all buttons that you want to turn off to 1. Any buttons associated with bits that are left as '0' will not be affected. The example on the right shows button 4 being cleared when C62 is active.

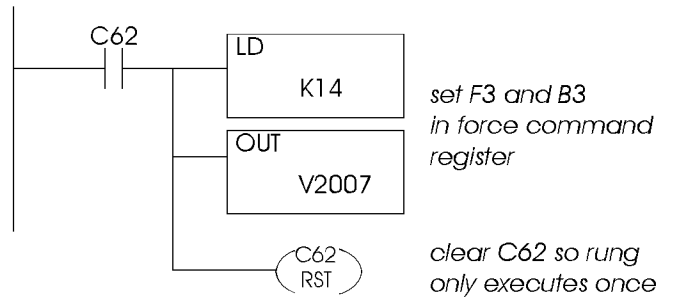


Forcing Setpoints

The OP-613 gives you the capability to force a setpoint to a value from the PLC.

To force a setpoint to a value, the value should be placed in register X+6. Next the force setpoint bit FSP and the bit(s) corresponding to the setpoint(s) to force to this value must be set in the force control register (X+7). When the OP-613 completes the force operation, it will clear the force control register.

The following example shows setpoint 4 being forced to 4321 when C75 is active.

Notice that C75 is used as a set/reset type relay. The force command should be written to the force register once. The OP-613 will automatically clear this register when the force is complete. This will normally happen very quickly (less than a second). The fact that the OP-613 clears the force control register when the operation is done can be used by the PLC program to verify operation. However, this is generally not necessary.

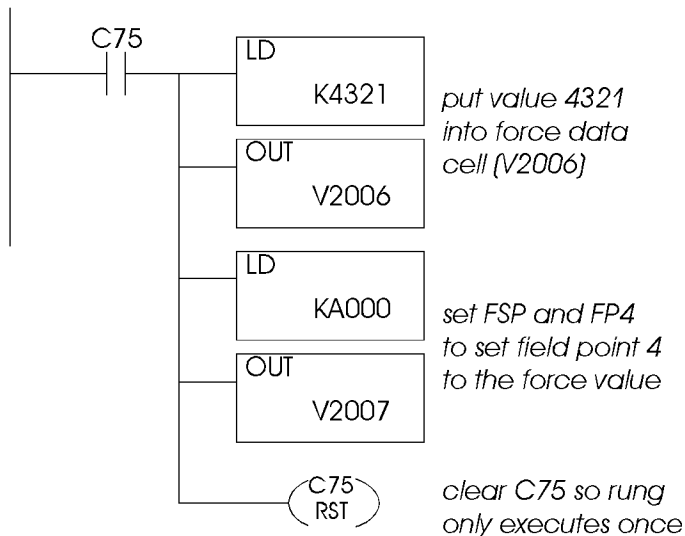

Examples of Use with an Allen Bradley PLC

Interfacing to A/B Memory

OptiMate modules interface to Allen Bradley SLC 5/03, SLC 5/04 and Micrologix PLCs via integer file type N. The 5/03 and 5/04 have file type N7 as standard. Other "N" type files can be created. The Micrologix has a fixed file type N7. Please refer to Allen Bradley documentaion for information on setting up and using "N" type files.


All of the examples that follow assume that the OP-613 module has been configured, through the OptiMate Configuration Editor, for a file number 7 and base register address 0. With this configuration, the lamp control and button status registers will be at N7:0 and N7:1 respectively. The following is a table relating lamp control and button status register bits to their N7 locations.

Lamp Control Register		Control Register	
bit	location	bit	location
B1	N7:0/0	B1	N7:1/0
B2	N7:0/1	B2	N7:1/1
B3	N7:0/2	B3	N7:1/2
B4	N7:0/3	B4	N7:1/3
L1	N7:0/5		
L2	N7:0/6		
B1F	N7:0/8		
B2F	N7:0/9		
B3F	N7:0/10		
B4F	N7:0/11		
L1F	N7:0/13		
L2F	N7:0/14		

Operations with Lights & Buttons


Turning on a Lamp

Turning on a lamp in the OP-613 simply requires activating its associated control relay coil. In the figure below, lamp 2 will be turned on whenever input I:0.0/4 is active (energizing N7:0/6).

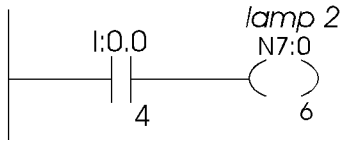


Flashing a Lamp

To flash a lamp, you simply need to both turn it on and set the associated flash bit. The example below shows a SLC program used to flash lamp 2 whenever I:0.0/7 is energized.

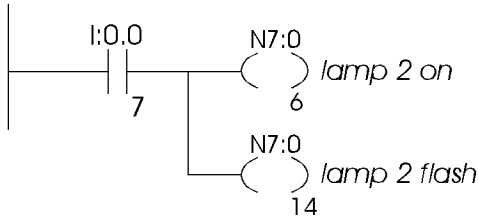


Using a Function Button

The four function buttons will appear as control relay coils in your program. The following example Turns on output Lamp 1 when button B2 is active.

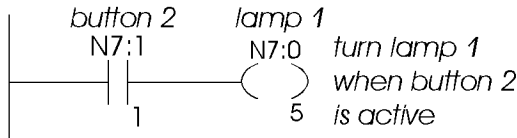

Lighting an Inset LED


In LED separation mode, the LEDs in the corner of each momentary pushbutton may be directly controlled by the PLC program. The following example shows a segment of a 205/405 program that will light button 2's inset LED whenever input I:0.3/1 is energized. In order for this to work, the panel must be configured for LED separation and button 2 must be a momentary pushbutton.

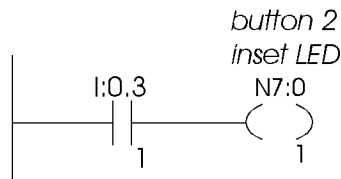


Flashing an Inset LED

To flash an inset LED, you simply need to both turn it on and set the associated flash bit. If the panel is not set up for LED separation, status is simply the button state. For momentary buttons with LED separation enabled, the on/off state is controlled by the PLC as shown in the previous example. For alternate action buttons, on/off state is always the button state.

The example below shows an A/B program used to set the LED inset in momentary button 2 to flash whenever input I:0.3/4 is energized.

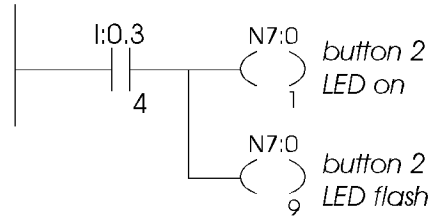

If the panel has been configured with button 2 being an alternate action button, the LED will operate as shown in the example and table below.

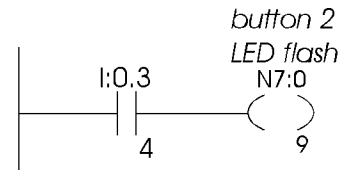


Button State	I:0.3/4 State	LED operation
Inactive	de-energized	Off
Inactive	energized	Off
Active	de-energized	On solid
Active	energized	Flashing

Setpoint & Display Operations

Displaying Numeric Data


Displaying numeric data in one of the 4 field points is a very simple process. During the initial configuration, make sure you define the point as a display point, not a setpoint. When this is done, the PLC program must simply put data to be displayed into the register associated with the display data field.

The figure on the right illustrates a numeric display application with an Allen-Bradley PLC. In this application, the OP-613 is configured for a base address of N7:0 and field point 2 for display. A value, held in N7:45 must be displayed in field point 2 as long as B3:22/3 is active. The example shows the value transferred from N7:45 to N7:3. It will be displayed as field point 2.

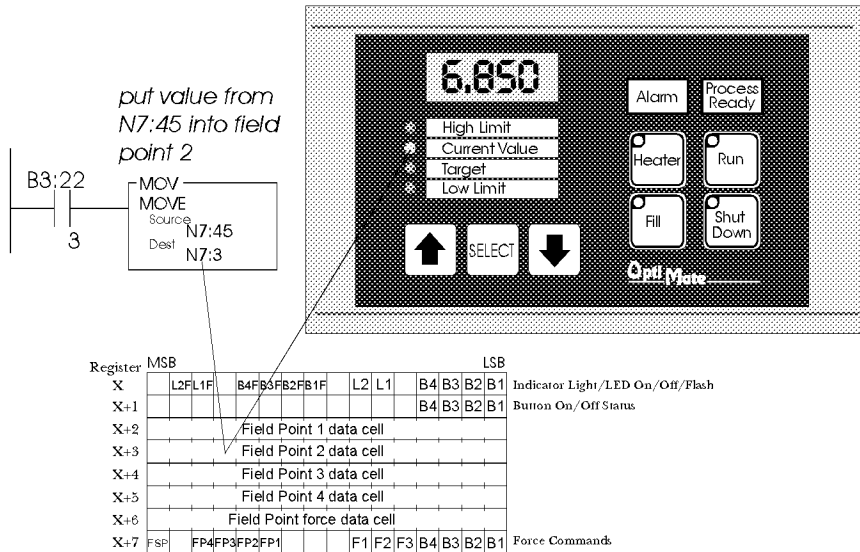

Reading a Setpoint

The following example uses an OP-613 at base address N7:0. Field point 3 has been configured as a setpoint. In the example program, field point 3 is a Target value setpoint. The program shown on the right checks a value, held in N7:52 against the setpoint. If the value exceeds the setpoint, O:0.0 will be turned on.

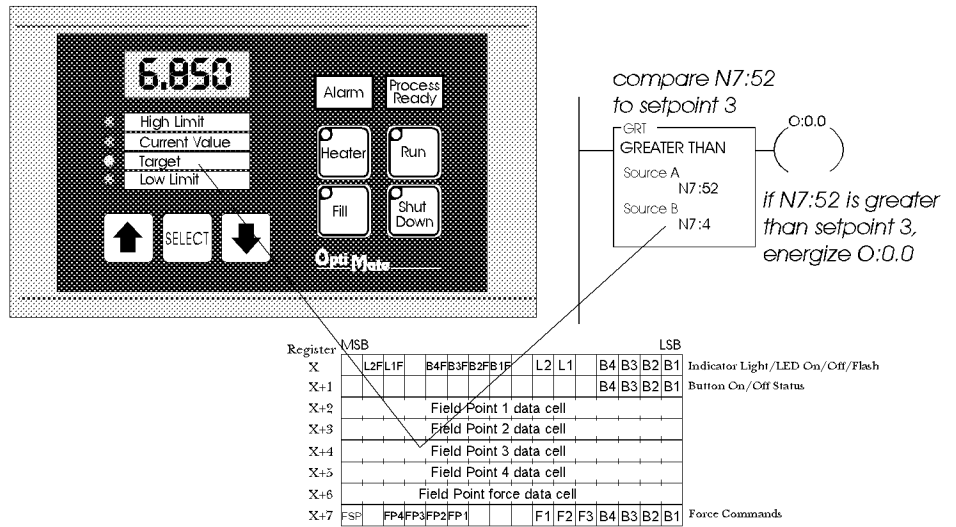

Using Force Functions

The OP-613 gives you the ability to force alternate buttons to a given state and force setpoints to a given value. This capability may or may not be used on a given application. There are applications when it is desirable to have the PLC program automatically set or clear a button based on operational state. There are also cases when forcing a setpoint to a predetermined value is useful. Obviously, this capability should be used carefully.

The last two registers in the register bank are associated with force operations. Their use is detailed below.

Forcing Button Status

One of the more advanced capabilities of the OP-613 panel is the ability to force button state from the PLC program. This may be desirable, for example, if an alternate action is used to start a function process. When it is pushed and while the function is active, the button will remain on. You may want the PLC program to clear the button at the end of the function process.

Another example is one of a system that has individual enable or on/off (alternate action) buttons for several different device. You may also have other buttons (probably momentary) that enable a group of these same devices. You may want your program to force on the device enable buttons when the group enable button is pressed.

There are many other cases where button force capability can be useful in a system.


There are three types of force functions available for the OP-613 panel - force status, force on and force off. All three functions require moving appropriate data into the PLC registers defined as Force Data & Commands (see the table described in "Use with a PLC").

Note : Force only applies to Alternate Action pushbuttons

Force Button Status


This function is used to set the state (on or off) of every alternate action pushbutton in the panel. To use the "Force Button Status" function, simply set the F1 bit to 1 and all buttons that you want to be on to 1, while leaving all other bits off. The example on the right shows buttons 1 and 2 being forced on and the other two buttons forced off when B3:4/2 is active.

The OP-613 will automatically clear register X+7 when the force is complete. This will normally happen very quickly (less than a second). The fact that the OP-613 clears the force control register when the operation is done can be used by the PLC program to verify operation. However, this is generally not necessary.

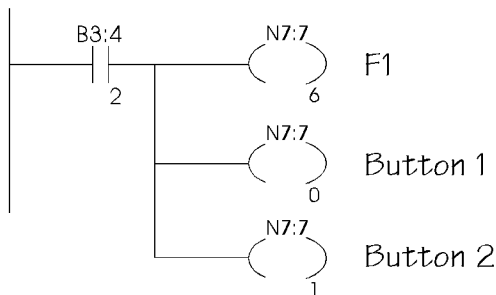


Force Button(s) On

This function is used to turn individual button(s) on without affecting the state of any other buttons. To use the "Force Buttons On" function, set the F2 bit to 1 and all buttons that you want to turn on to 1. Any buttons associated with bits that are left at '0' will not be affected. The following example shows button 3 being forced on when B3:4/2 is active.

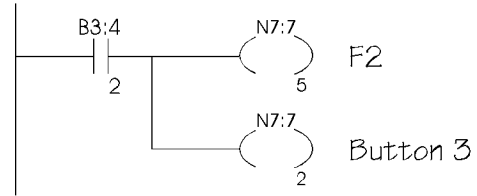

Clear Button(s)

This function is used to selectively turn individual button(s) off without affecting the state of any other buttons. To use the "Clear Buttons" function, set the F3 bit to 1 and all buttons that you want to turn off to 1. Any buttons associated with bits that are left as '0' will not be affected. The example on the right shows button 4 being cleared when B3:4/4 is active.

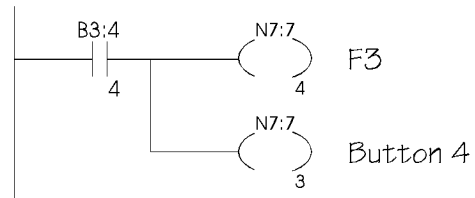


Forcing Setpoints

The OP-613 gives you the capability to force a setpoint to a value from the PLC.

To force a setpoint to a value, the value should be placed in register X+6. Next the force setpoint bit FSP and the bit(s) corresponding to the setpoint(s) to force to this value must be set in the force control register (X+7). When the OP-613 completes the force operation, it will clear the force control register.

The following example shows setpoint 4 being forced to 4321 when B3:4/2 is active.

The force command should be written to the force register once. The OP-613 will automatically clear this register when the force is complete. This will normally happen very quickly (less than a second). The fact that the OP-613 clears the force control register when the operation is done can be used by the PLC program to verify operation. However, this is generally not necessary.

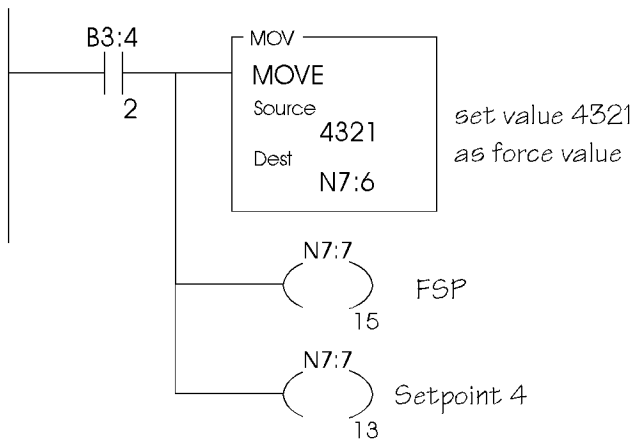


Set Up and Interconnect

Legending the Field Points, Lamps and Function Keys

Legending the OP-613 module is a relatively simple process that basically involves sliding legend transparencies into pockets in the panel overlay. Use the following procedure.


- Remove the bezel from the module. The bezel snaps to the module box along the top and bottom edges. Pull the bezel out and over the snaps to remove.



- Create legend transparencies.


There are a number of available options for doing so. Patterns are provided on the next to last sheet of this document.

- > Use the built in label making capability of the OP-WINEDIT software to create labels. Either print on the transparency directly or print on paper and photocopy onto the transparency. The figure below is a screen from OP-WINEDIT which illustrates the process.

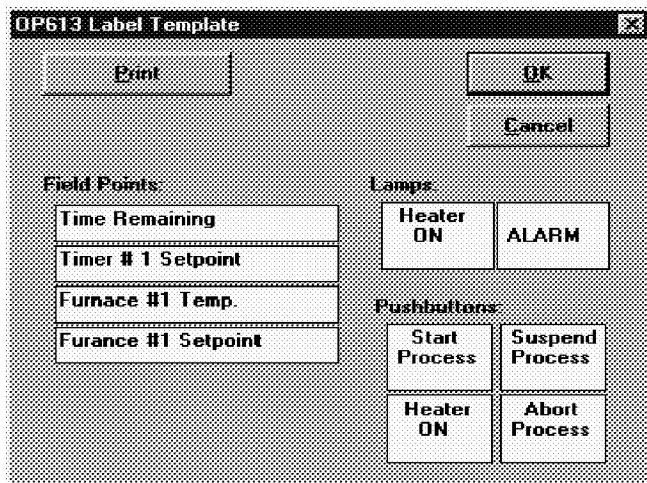

- > Use a computer graphics program and a laser printer to create the transparency directly. Alternately print on paper and photocopy to a transparency.
- > Use press on letters onto a transparency sheet.
- > Use a typewriter or lettering machine to letter onto paper, then photocopy

- Cut along outline. Slide into overlay pocket. Pushbutton legends slide in from the bottom.
- Re-attach bezel. Push bezel onto box until it snaps together.

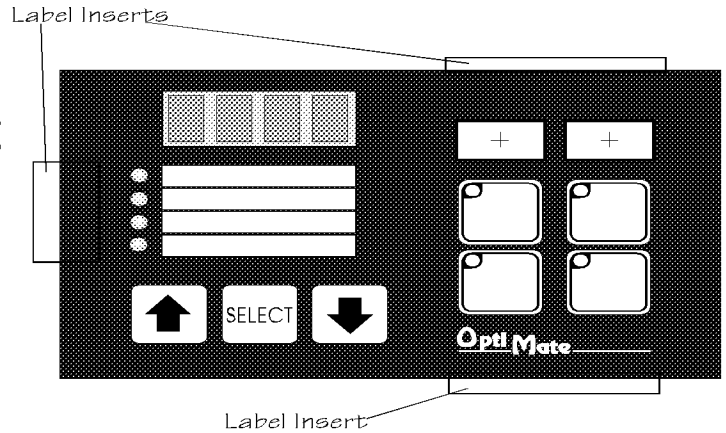


Connection to the System

OptiMate modules are designed for communications connection to system devices. The module can be connected to a computer, PLC or communication master over the serial port (RS232 or RS422).

Connection to a Computer or PLC

Connection of an OptiMate module to a computer or PLC can be accomplished over either an RS232 or RS422 link. RS232 is limited to one OptiMate module to one computer serial port. RS422 allows up to 31 modules to be connected to one computer port. Since PLCs are slave devices, the RS422 link for a PLC is limited to one OptiMate module.

Refer to manufacturer's documentation for PLC or computer serial link connector pinouts.

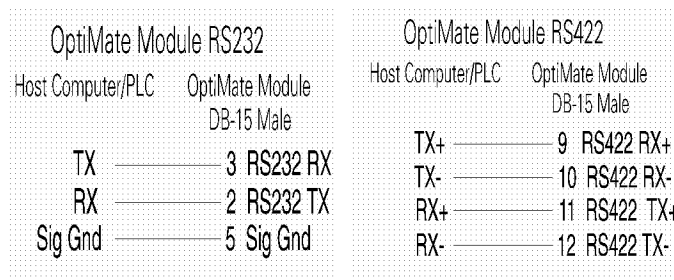


Standard cables are available for connection to several different PLCs as well as to IBM PCAT compatible ports.

Serial Connection to Communications Master

Connection to an Optimization Communications Master over a serial link is via RS422. The Communication master port connections are reversed from the module ports to enable direct pin to pin connection. For distances under 50 feet (in a low electrical noise environment), a ribbon cable connection works quite well. For longer distances or in noisy environments, a two pair shielded RS422 cable is recommended.

Termination

The termination DIP switch on the back of the panel switches in a terminating resistor. This terminating resistor does not apply to an RS232 connection (and should be in the OFF position for RS232). In an RS422 connected system, such as with the OP-9001 Communication Master, the termination should be on in the last, and only the last, panel on the cable.

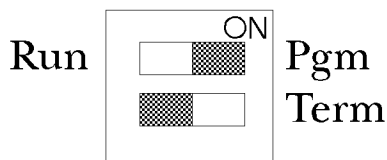

Power

The OP-613 panel will operate on any DC voltage between 8 and 30VDC. Steady state current is listed on the specification page.


There is a very brief (0.5 - 2 millisecond) power on surge up to 1.5 amps. This is typical of nearly any type of electronic equipment and is due to the initial charging of power capacitors. This surge is not normally a problem for a commercial power supply.

Configuration

Configuration of the OP-613 operator panel or system of OptiMate panels is performed via an IBM PC compatible computer. The OP-WINEDIT configuration software that allows you to select panel type, panel application, system configuration and PLC protocol definition.

If the OP-613 is to be operated stand alone with a PLC, the configuration selection must be made to select the proper PLC protocol information. If it is part of a multi-panel system, the OP-WINEDIT software will automatically set up communications between the OP-9001 and the panel via OptiMate Hex.

Note : When configuring, always remember to set the Run/Pgm DIP switch on the back of the panel to Pgm (towards the "ON") before applying power to the module. When you are finished downloading the

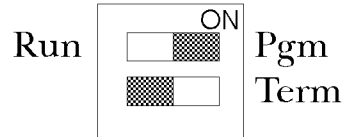

configuration, power down the panel and switch to the "Run" position before connecting to the PLC.

Specific configuration of the OP-613 begins with defining the block of PLC register data to be used. Next, each of the function buttons must be configured for either momentary or alternate action operation. Then each of the field points must be configured for setpoint or display. Additional options exist for setpoint range limits, LED separation (or not), and force enable/disable.

OP613 Configuration

Panel Address: 0
 PLC Base Register Address: V2000

Write to Panel

Close

Labels

Panel

Pushbuttons

#1: A M
 #2: A M
 #3: A M
 #4: A M

{A = Alternate}
 {M = Momentary}

Options

Force Option
 LED Separation

Configure Field Points:
 To modify a field point, type the point number in the box below or select the point from the list, then press the 'Modify' button.

Configure Field Point#: 2

Modify

Point	Type	Format	Digits	Range
1:	Setpoint	BCD	0	0-9999
2:	Display	BCD	0	0-9999
3:	Setpoint	BCD	0	0-9999
4:	Setpoint	BCD	0	0-9999

Configuration Selections

OptiMate modules can be configured for the specific application by using the OptiMate Configuration Editor. The Configuration Editor runs on any IBM PC compatible computer. It allows the user to select the exact functionality to meet application requirements.

For the OP-613 module, the following are important configuration parameters.

Single Panel PLC Based Systems


Decision	Selection
Single/ Multi Module	Choose single module configuration
Configuration starting point	First time configuration start with defaults for module. Subsequent configurations can utilize disk files you create
PLC Type	Select appropriate PLC type
Protocol	Select appropriate baud rate, # data bits, # stop bits & parity. Note that if 8 data bits and even or odd parity selected, only 1 stop bit is available
Buttons	Select momentary or alternate action as required for your application
Field Points	Define as setpoints or display points as required. Define number format in PLC (binary or BCD) For setpoints, define limits.
LED separation	If the LEDs inset in the momentary pushbuttons are to be controlled by the PLC program, rather than reflect button state, enable. Otherwise, disable.
Force option	If you intend to force button states or setpoint values, enable the force option.

Multi Panel PLC Applications (Uses Communications Master)


Decision	Selection
Single/Multi Module	Chose Multi panel
PLC Type	This applies to the Communications master. Choose appropriate type
Address	Each panel must have a unique address.
Protocol	This applies to the Communications master. Choose appropriate baud rate, # bits, # stop bits & parity. Note that if 8 data bits and even or odd parity are selected, only 1 stop bit is available.
Module Protocol	Choose OptiMate Hex
Buttons	Select momentary or alternate action as required for your application
Field Points	Define as setpoints or display points as required. Define number format in PLC (binary or BCD) For setpoints, define limits.
LED separation	If the LEDs inset in the momentary pushbuttons are to be controlled by the PLC program, rather than reflect button state, enable. Otherwise, disable.
Force option	If you intend to force button states of setpoint values, enable the force option.

Configuration must be downloaded from the IBM PC compatible to each module. This is done over the serial link. Module address must be selected for PGM (DIP switch on back of module) prior to application of power for module to accept configuration data. The module must be powered down and the DIP switch changed to "Run" before re-applying power for the module to operate with the selected host. Communication cable is available from Optimization.


Label Templates

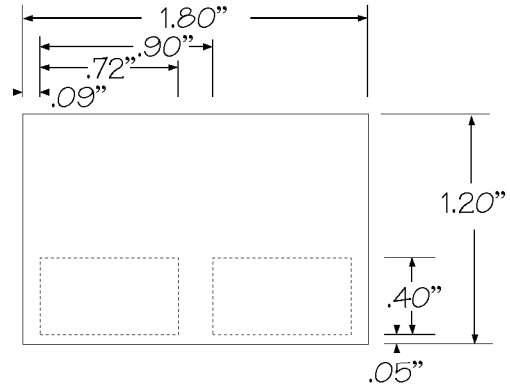

Lamp Label Insert Template

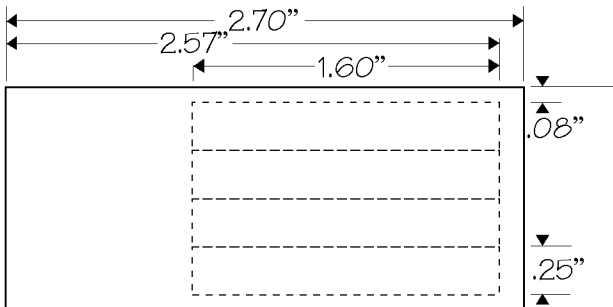

Field Point Label Insert Template

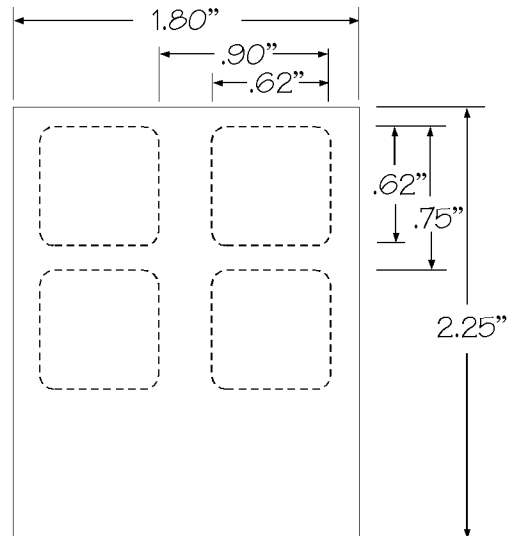


Pushbutton Label Insert Template

Specifications

Physical


- Recessed Mount Housing 6.6"L x 4.0"H x 1.25"D
- Cutout size for above 3.55"Hx5.80"L
- Panel Fasteners : Four, 6x32 threaded studs, shown above (on ends, symmetrical about center line)
- Weight : 10 ounces
- Colors : Dark gray housing with dark gray panel. Keypad keys; white with gray letters. Function keys ; White with user supplied label.
- Numeric LED height : 0.35 inch
- Pushbutton life : 1,000,000 switch cycles
- Lamp Colors : Red, Green
- Lamp window size : 0.7" x 0.4"

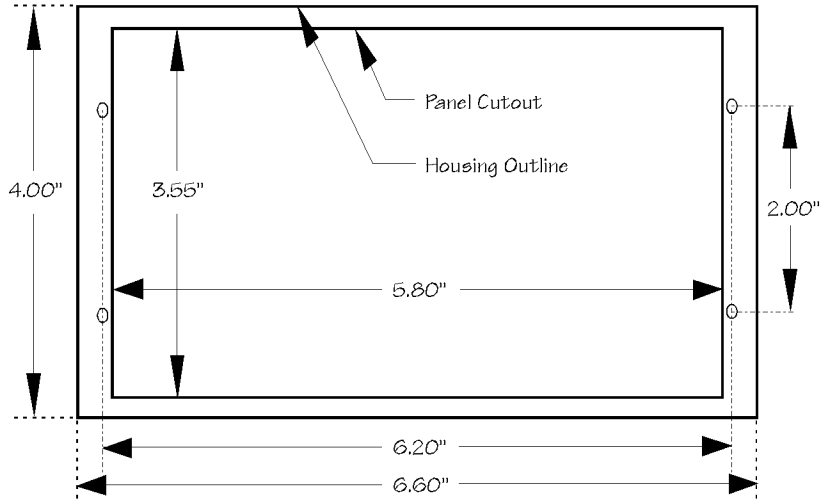

Panel Mounting Dimensions

Electrical

- Power (all lamps on) : 8 - 30VDC @ 2.2Watts
180 mA @ 12VDC 90 mA @ 24VDC
- Power On Surge (see figure below)
1.5A for 2 milliseconds max

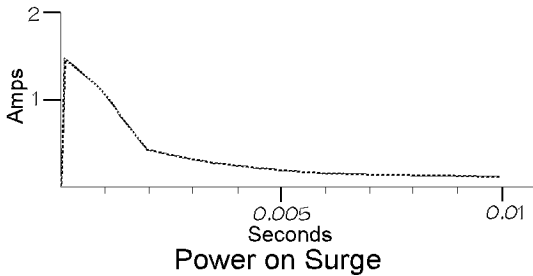

Environmental

- Enclosure - NEMA 4 (when properly installed)
- Temperature - 0 to 50 C
- Humidity - 95% Non-condensing

- Power connector :
Pluggable terminal block, 2 position

Communications

- RS232 and RS422
- 4800 to 19200 baud
- Compatible with major PLC protocols
- 15 pin female 'D' shell connector

Communications Failure Operation

Should the module (when not selected for configuration) ever fail to communicate successfully for a period of 12 seconds, the light bars and LEDs will flash rapidly.